ग्रिड-इंडिया
GRID-INDIA

ग्रिड कंट्रोलर ऑफ इंडिया लिमिटेड
(भारत सरकार का उद्यम)
GRID CONTROLLER OF INDIA LIMITED
(A Government of India Enterprise) [Formerly (POSOCO)]
दक्षिण क्षेत्रीय भार प्रेषण केन्द्र/ Southern Regional Load Despatch Centre

कार्यालय : २९, रेस कोर्स क्रॉस रोड, बेंगलूरु ५६० ००९.
Office : 29 Race Course Cross Road, Bengaluru 560 009.
CIN NO : U40105DL2009GOI188682, Website : www.srldc.in, E-mail : srldc@grid-india.in Tel : 080-2225004/45,25, Fax : 080-22268725

संदर्भ /Ref No: GRID-INDIA/SRLDC/ RTO/2026/Oct/15 **दिनांक/Date**: 29-10-2026

To
JPL-Simhapuri Plant Head,
Simhapuri Energy Limited,
Chillakur Mandal, Nellore District,
Thamminapatnam Andhra Pradesh-524412

विषय / Subject: Deviation from Schedule by Jindal Power Limited (Simhapuri Unit)

Dear Sir,

This is to bring to your attention that significant under-injection, up to 368 MW, was observed from Jindal Power Limited (Simhapuri) Generating Station during certain instances in October 2026.
The unit tripping details for Simhapuri units are as follows:

Unit Name	Reason	Tripping time	Synching time
JINDAL POWER LIMITED (Simhapuri Unit) - UNIT 2	PA fan-2B fan vibration high .	2026-10-24 07:08	2026-10-26 11:51
JINDAL POWER LIMITED (Simhapuri Unit) - UNIT 1	VT fuse failure	2026-10-23 11:11	2026-10-23 13:08
JINDAL POWER LIMITED (Simhapuri Unit) - UNIT 2	LHS Cyclone down leg bellow Damage	2026-10-18 00:44	2026-10-22 14:26
JINDAL POWER LIMITED (Simhapuri Unit) - UNIT 4	PA Fan bearing vibration malfunction	2026-10-12 04:55	2026-10-12 06:27
JINDAL POWER LIMITED (Simhapuri Unit) - UNIT 4	RHS CYCLONE DOWN LEG BELLOW LEAKAGE	2026-09-28 07:36	2026-10-05 13:52
JINDAL POWER LIMITED (Simhapuri Unit) - UNIT 3	metallic bellow leakage	2026-10-22 21:18	

The maximum deviation of 368 MW occurred on 23rd October 2026 evening 18:40hrs. During this day, unit-1 was tripped during 11:11hrs and synched at 13:08hrs, still deviation was continuing throughout the day. This recurrent under-injection by Jindal Power Limited (Simhapuri) during peak hours adversely affect grid reliability. Accordingly, Jindal Power Limited (Simhapuri) is requested to:

a) Declare DC strictly as per on-bar unit availability.
b) Avoid over-declaration and scheduling beyond unit capacity.
c) Align schedules through assured sources such as DAM or bilateral trades.


It is therefore requested to kindly honour the schedules and refrain from any deviations to ensure secure and reliable grid operation.

भवदीय /Yours faithfully
वी गोविन्दराज
29/10/2026
वी गोविंदराज / V Govindaraj
मुख्य महाप्रबंधक / Chief General Manager(SO)
एसआरएलडीसी/ SRLDC

Enclosed: Deviation of Simhapuri from 21st October to 28th October 2026
Copy to:
1. ED, NLDC, Grid-India, New Delhi
2. ED, SRLDC, Bengaluru

पंजीकृत कार्यालय : बी– 9, प्रथम तल कुतुब इंस्टीट्यूशनल एरिया, कटवारिया सारय, नई दिल्ली – 110 016.
Registered Office : No. B-9, 1st Floor, Qutab Institutional Area, Katwaria Sarai, New Delhi - 110 016.
Website : www.grid-india.in

Annexure

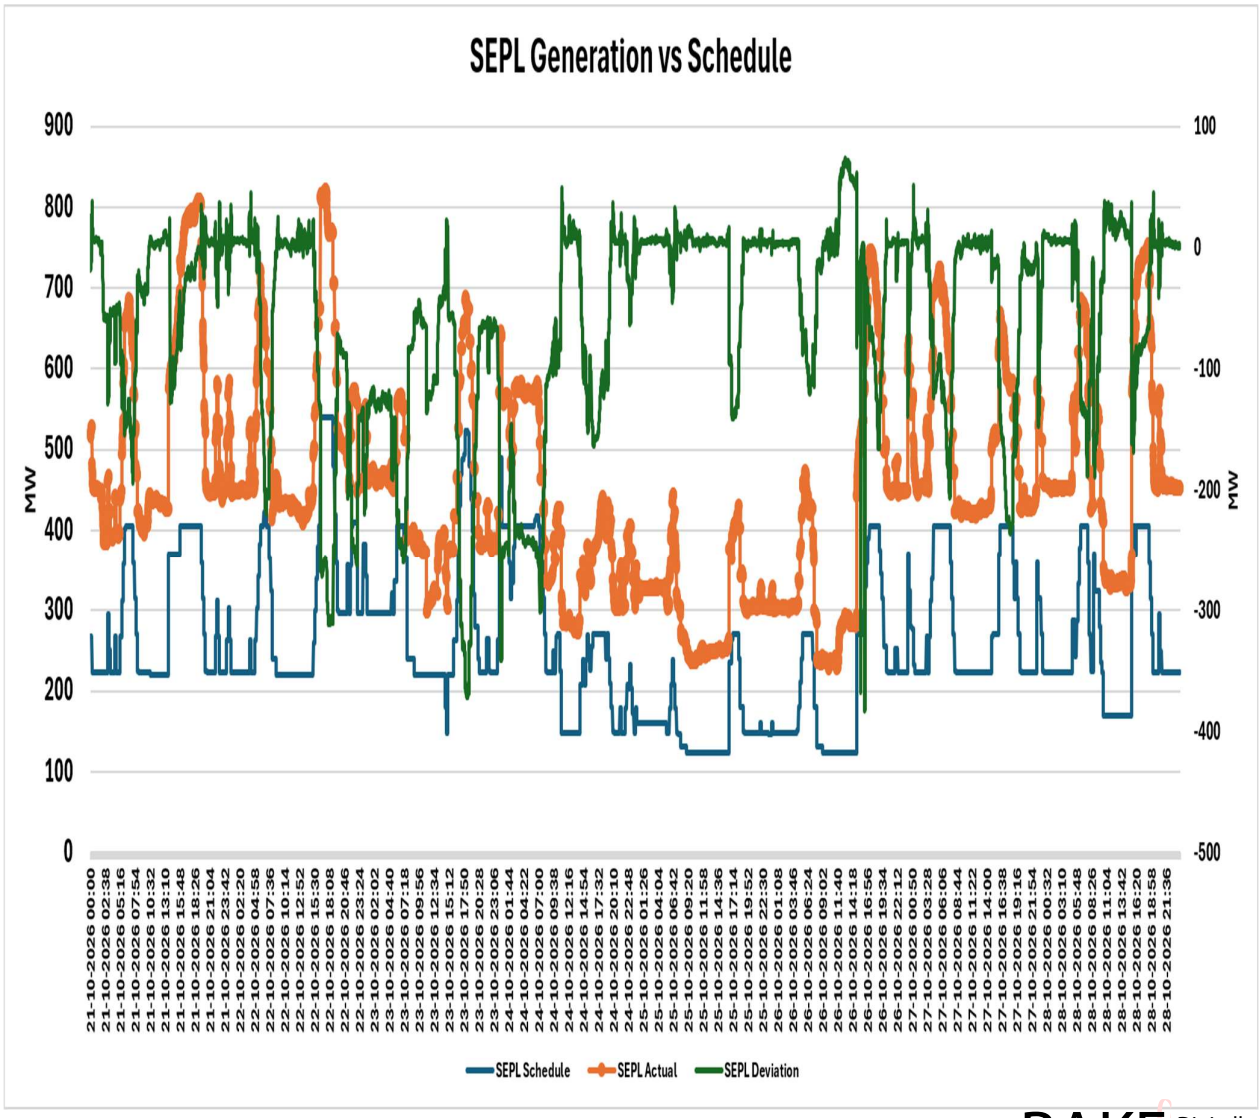

RAKESH K

Digitally signed by RAKESH K
Date: 2026.10.29 15:37:16 +05'30'